

WTP-103 DRINKING WATER SYSTEM WATERWORKS # 220010681

LARGE MUNICIPAL RESIDENTIAL ANNUAL WATER REPORT

PREPARED FOR
The Township of Ramara

SUBMITTED BY
Ontario Clean Water Agency
2085 Hurontario Street, Suite 500
Mississauga, ON L5A 4G1

Reporting Period: January 1 – December 31, 2025

Issued: February 13, 2026

Revision: 0

Operating Authority: Ontario Clean Water Agency (OCWA)

This report has been prepared to satisfy the annual reporting requirements in O. Reg. 170/03 Section 11 and Schedule 22

Table of Contents

1. Report Availability	1
2. Compliance Report Card.....	1
3. System Process Description	1
Raw Source.....	1
Treatment	1, 2
Treatment Chemicals used during the reporting year:.....	2
4. Summary of Non-Compliance	2
Adverse Water Quality Incidents	2
Non-Compliance.....	2
Non-Compliance Identified in a Ministry of the Environment Conservation and Parks Inspection	3
Community Complaints.....	3
Flows.....	3
Raw Water Flows	3
Total Monthly Flows (m ³ /d).....	3
Monthly Rated Flows (L/s).....	4
Treated Water Flows.....	4
System Reserve Capacity	5
Monthly Rated Flows	5
Annual Total Flow Comparison	6
5. Regulatory Sample Results Summary.....	6
Microbiological Testing	6
Operational Testing.....	6, 7
Inorganic Parameters.....	7
Schedule 15 Sampling:.....	8

Organic Parameters 8, 9

Additional Legislated Samples 10, 11

Inorganic or Organic Parameter Exceedances 11

**6. Major Maintenance Summary incurred to install, repair or replace required equipment
..... 12**

Appendix A – WTRS Data Submission Confirmation

1. Report Availability

This system does not serve more than 10,000 residence and the annual reports will be available to residents at the Township of Ramara Administration Office and on the Township’s website at www.ramara.ca. Notification that reports are available free of charge will be made on the Township of Ramara website. The Township of Ramara Administration Office is located at 2297 Highway 12, Brechin, ON L0K 1B0.

2. Compliance Report Card

Drinking Water System Number: 220010681

Drinking Water System Name: WTP-103 (South Ramara DWS)

Drinking Water System Owner: Township of Ramara

Drinking Water System Category: Large Municipal Residential

Period Being Reported: January 1, 2025 - December 31, 2025

Health & Safety	# of Events	Date	Details
Number of Incidents	0	N/A	N/A

Drinking Water	# of Events	Date	Details
Ministry of the Environment Conservation and Parks (MECP) Inspections	2	February 11, 2025	Announced Focused Drinking Water Inspection for 2024 cycle completed. Final inspection rating – 100%
		January 19, 2026	Drinking Water Inspection completed for 2025 cycle. Final rating not yet received.
AWQI’s	0	N/A	N/A
Number of Non-Compliances	0	N/A	N/A
Number of Boil Water Advisories	0	N/A	N/A

3. System Process Description

Raw Source

The South Ramara DWS is supplied with surface water from Lake Simcoe.

Treatment

The treatment system consists of the following:

- Raw water is sourced from Lake Simcoe through an intake crib with an inlet screen further the low lift pumping station consisting of two (2) low lift pumps
- Inlet line connected to sodium hypochlorite feed line diffuser
- Raw water flow meter
- Carbon Dioxide injection system for adjusting pH to optimize coagulation process with a metering panel equipped with actuated control valve and bypass piping, gas feed flowmeter, filter, carbon dioxide gas pressure regulator and isolating manual ball valves
- Sodium hypochlorite is added for pre-chlorination
- Coagulant is added to the raw water header before a static mixer
- Two (2) package treatment units each consisting of a flocculation tank with variable speed flocculators, settling tanks and dual media filter with rotary surface wash and backwash pumps
- Backwash waste storage/decant tank system. Supernatant is de-chlorinated before being pumped to Lake Simcoe
- Continuously monitoring turbidity analyzers on each filter line
- Chlorine injection system
- Two (2) above ground clearwells with two highlift pumps
- Chlorine residual and pH analyzers prior to distribution connection
- SCADA computer control system
- Standby power generator

Treatment Chemicals used during the reporting year:

Chemical Name	Use	Supplier
Sodium Hypochlorite	Disinfection	Brenntag
Poly-Aluminum Chloride	Flocculation	Brenntag
Carbon Dioxide	pH Optimization	Praxair
Calcium Thiosulphate	De-chlorination	ClearTech

4. Summary of Non-Compliance

Adverse Water Quality Incidents

Date	AWQI #	Location	Details	Legislation	Corrective Action Taken
August 8, 2025	169368	Treated Water	High Sodium Result of 39.6 mg/L.	O. Reg 170/03	Re-sampled TW on August 11, 2025, result = 37.5mg/L. Sodium Notices made public through the Township of Ramara.

Non-Compliance

Legislation	Requirement(s) system failed to meet	Duration of the failure (i.e. date(s))	Corrective Action	Status
There were no non-compliance issues reported during the reporting period.				

Non-Compliance Identified in a Ministry of the Environment Conservation and Parks Inspection:

Legislation	Requirement(s) system failed to meet	Duration of the failure (i.e. date(s))	Corrective Action	Status
There were no non-compliances identified in a Ministry of the Environment Conservation and Parks Inspection during the reporting period.				

Community Complaints

Date	Details	Corrective Action Taken
December 11, 2025	Received complaint regarding coloured water	Notified resident to run water until clear and to notify if discolouring continues.

Flows


The South Ramara Drinking Water System is operating on average under half the rated capacity.

Raw Water Flows

The Permit to Take Water compliance criteria is in litres per minute (L/min) but for the purposes of this report the flow rate is reported in litres per second (L/sec) based on industry standard for flow monitoring recording. The Raw Water flows are regulated under the Permit to Take Water. 2025 Raw Flow Data was submitted to the Ministry of the Environment Conservation and Parks electronically under permit #P-300-1030655871. The confirmation of the data that was submitted are attached in Appendix A.


Total Monthly Flows (m³/d)

Max Allowable PTTW –Raw

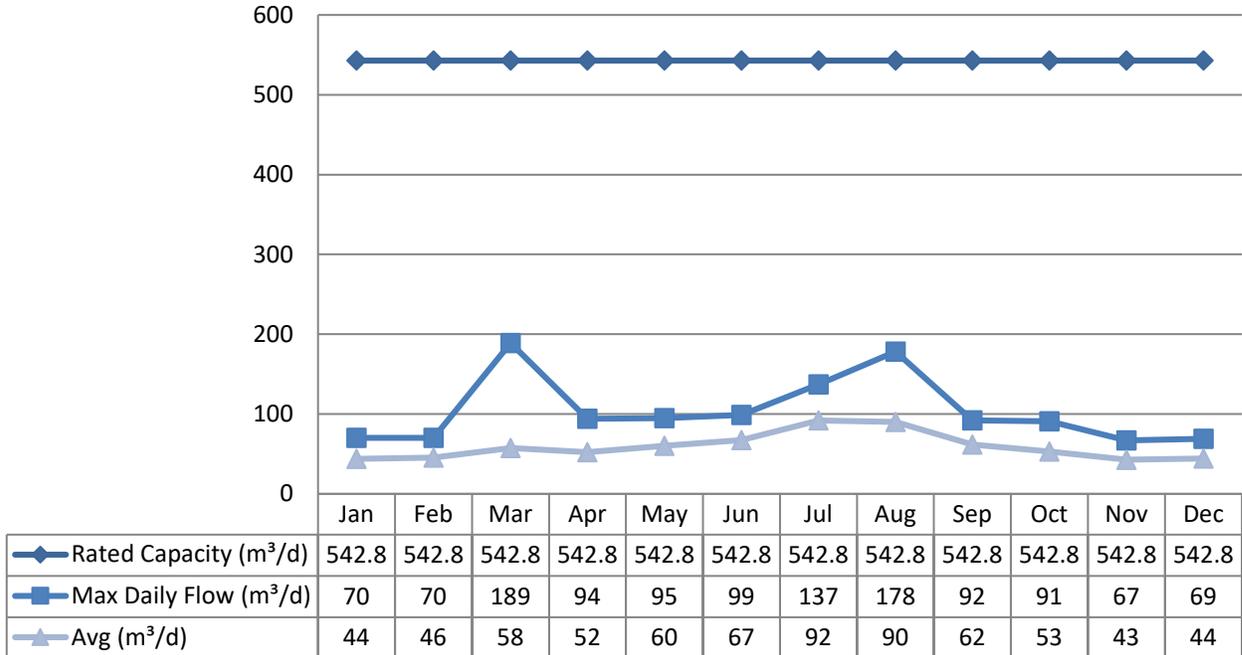

Monthly Rated Flows (L/s)

Max allowable rate – PTTW –Raw

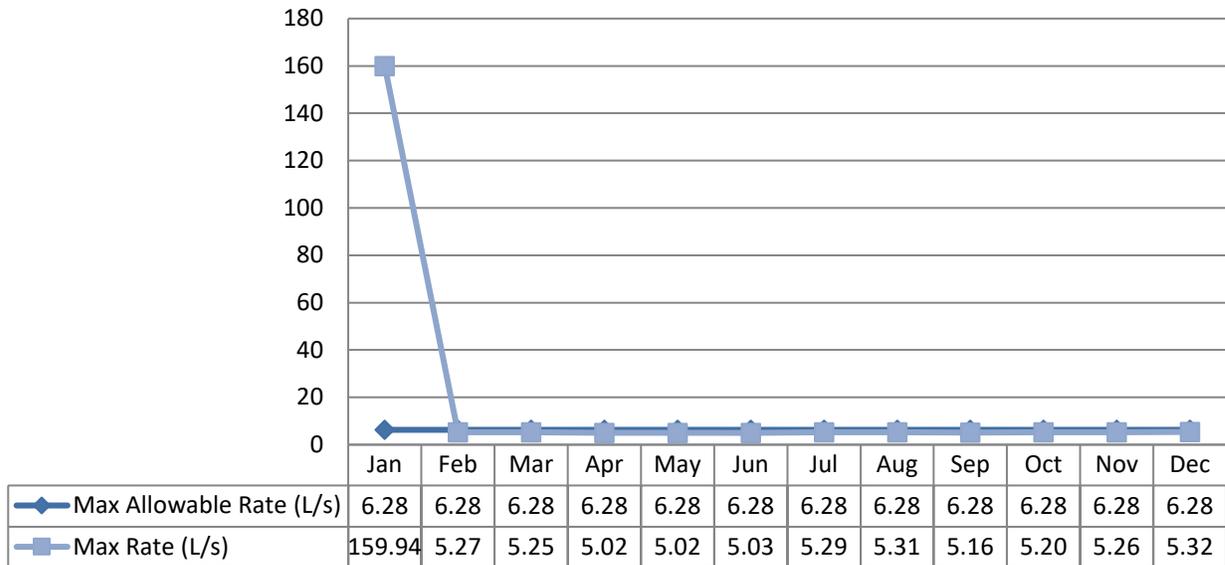

Note: The above table shows there were exceedances in instantaneous peak flow rate (L/s) which were caused by flow meter calibrations. All spikes are reviewed for compliance.

Treated Water Flows

The Treated Water flows are regulated under the Municipal Licence. The average water consumption for

the South Ramara Drinking Water System during 2025 was: 48 m³/day.

South Ramara Drinking Water System Historical Demands

Year	Number of Connections	Average Daily Demand (m ³)	Maximum Daily Demand (m ³ /day)	Rated Capacity	Per Capita Consumption* (L/p/day)	
					Average	Maximum
2015	102	51	124	387	193	468
2016	104	54	148	387	200	547
2017	104	40.5	104	387	150	385
2018	106	41.7	111	387	151	402
2019	114	46.9	135	387	158	689
2020	115	58.2	175	387	195	585
2021	115	53	128	387	177	428
2022	132	52	124	387	153	361
2023	132	48	97	387	140	283
2024	133	39	107	387	113	309
2025	133	48	171	387	139	494
3 Year Average/Max		45	125	387	131	362

*Based on 2.6 people per dwelling

Note: Excluding pipe leaks/breaks & system flushing

Note: This calculation was completed based on current connections in the system, growth within the drinking water system has not been considered.

System Reserve Capacity

In accordance with the MECP Procedure D-5-1, the reserve capacity is calculated by the following formula:

Reserve Capacity= Design Flow- Committed Flow


Design flow is the maximum permissible flow approved by the MDWL and/or PTTW. South Ramara Water Works maximum daily rated capacity is 387 m³/day.

The committed flow is the total expected water demand from the existing and proposed connections based on the previous three years of data. The committed number of service connections is: 155. The three-year (2023-2025) maximum per capita water consumption is: 362 L/p/day. At this water consumption rate, the committed flow is: 146 m³/day.

As a result, the calculated reserve capacity is: 241 m³/day.


Monthly Rated Flows

Rated Capacity – MDWL

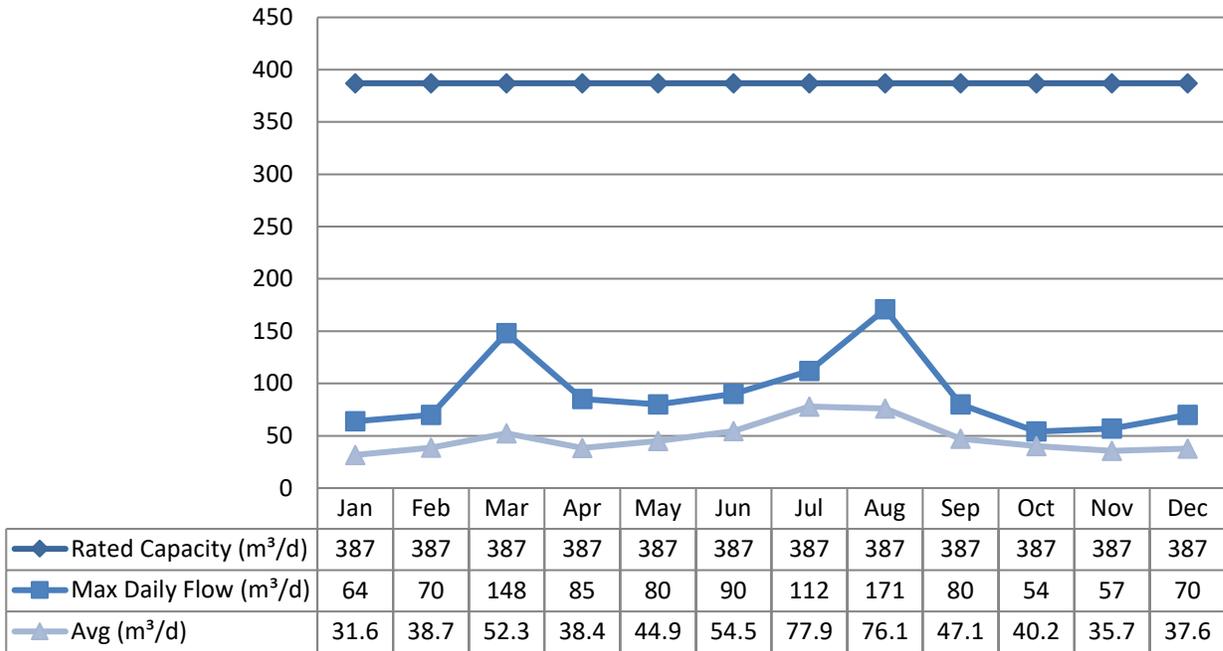

Annual Total Flow Comparison

Total Annual m³

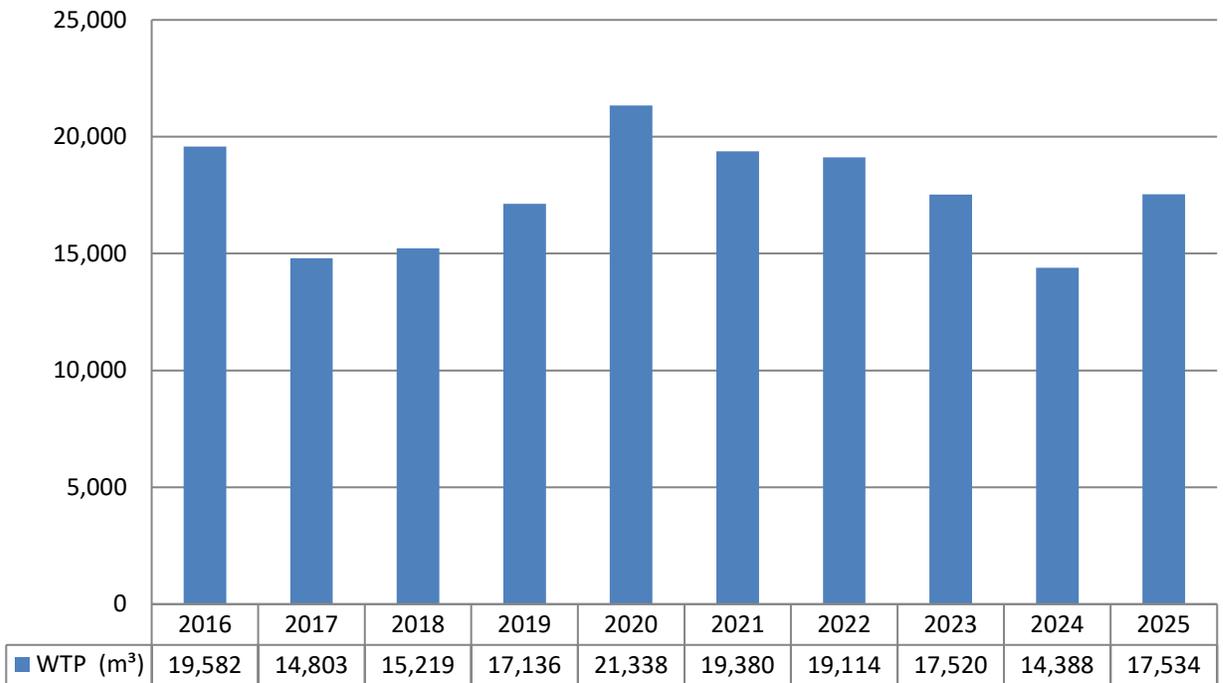

5. Regulatory Sample Results Summary

Microbiological Testing

	No. of Samples Collected	Range of E. Coli Results		Range of Total Coliform Results		Range of HPC Results	
		Min	Max	Min	Max	Min	Max
Raw	52	0	20	0	440		
Treated	52	0	0	0	0	0	2
Distribution	105	0	0	0	0	0	11

Operational Testing

	No. of Samples Collected	Range of Results	
		Minimum	Maximum
Turbidity – Filter Line 1 (NTU)	8760	0.50	10.01
Turbidity – Filter Line 2 (NTU)	8760	0.01	10.32
Turbidity-Treated (NTU)	8760	0.00	10.00
Treated Water Chlorine	8760	0.00	3.33
Distribution Water Chlorine	365	0.38	2.15
Fluoride (If the DWS provides fluoridation)	N/A	N/A	N/A

Note: Record the unit of measure if it is **not** milligrams per litre.

Note: For continuous monitors 8760 is used as the number of samples. Spikes recorded by on-line instrumentation were a result of air bubbles and various maintenance/calibration activities. All spikes are reviewed for compliance with O. Reg. 170/03.

Inorganic Parameters

These parameters are tested as a requirement under O. Reg. 170/03. Sodium and Fluoride are required to be tested every 5 years. Nitrate and Nitrite are tested quarterly and the metals are tested annually as required under O. Reg. 170/03. In the event any of the parameters exceed half of the maximum allowable concentration the parameter is required to be sampled quarterly.

- MAC = Maximum Allowable Concentration as per O. Reg. 169/03
- MDL = Method Detection Limit

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Exceedances	
				MAC	1/2 MAC
Treated Water					
Antimony: Sb (ug/L) - TW	2025/08/05	<MDL 0.6	6.0	No	No
Arsenic: As (ug/L) - TW	2025/08/05	0.3	10.0	No	No
Barium: Ba (ug/L) - TW	2025/08/05	30.0	1000.0	No	No
Boron: B (ug/L) - TW	2025/08/05	24	5000.0	No	No
Cadmium: Cd (ug/L) - TW	2025/08/05	<MDL 0.003	5.0	No	No
Chromium: Cr (ug/L) - TW	2025/08/05	0.22	50.0	No	No
Mercury: Hg (ug/L) - TW	2025/08/05	<MDL 0.01	1.0	No	No

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Exceedances	
				MAC	1/2 MAC
Selenium: Se (ug/L) - TW	2025/08/05	0.07	50.0	No	No
Uranium: U (ug/L) - TW	2025/08/05	0.054	20.0	No	No
Additional Inorganics					
Fluoride (mg/L) - TW	2022/08/03	<MDL 0.06	1.5	No	No
Nitrite (mg/L) - TW	2025/02/03	<MDL 0.003	1.0	No	No
Nitrite (mg/L) - TW	2025/05/05	0.003	1.0	No	No
Nitrite (mg/L) - TW	2025/08/05	<MDL 0.003	1.0	No	No
Nitrite (mg/L) - TW	2025/11/03	<MDL 0.003	1.0	No	No
Nitrate (mg/L) - TW	2025/02/03	0.174	10.0	No	No
Nitrate (mg/L) - TW	2025/05/05	0.413	10.0	No	No
Nitrate (mg/L) - TW	2025/08/05	0.015	10.0	No	No
Nitrate (mg/L) - TW	2025/11/03	0.017	10.0	No	No
Sodium: Na (mg/L) - TW	2025/08/05	39.6	20*	N/A	N/A
Sodium: Na (mg/L) - TW	2025/08/11	37.5	20*	N/A	N/A

*There is no "MAC" for Sodium. The aesthetic objective for sodium in drinking water is 200 mg/L. The local Medical Officer of Health should be notified when the sodium concentration exceeds 20 mg/L so that this information may be communicated to local physicians for their use with patients on sodium restricted diets.

Schedule 15 Sampling:

The Schedule 15 Sampling is required under O. Reg. 170/03. This system is under reduced sampling. No plumbing samples were collected.

Distribution System	Number of Samples	Range of Results Minimum	Range of Results Maximum	MAC (ug/L)	Number of Exceedances
Alkalinity (mg/L)	2	120	121	N/A	N/A
pH	2	7.30	7.70	N/A	N/A
Lead (ug/l)	2	0.01	0.05	10	0

Note: Lead is required to be sampled every 3 years and is scheduled to be sampled in 2028.

Organic Parameters

These parameters are tested annually as a requirement under O. Reg 170/03. In the event any of the parameters exceed half of the maximum allowable concentration the parameter is required to be sampled quarterly.

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Exceedances	
				MAC	1/2 MAC
Treated Water					
Alachlor (ug/L) - TW	2025/08/05	<MDL 0.02	5.00	No	No

REV. 0 SOUTH RAMARA DRINKING WATER SYSTEM – 2025 ANNUAL REPORT

ISSUED: FEBRUARY 13, 2026

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Exceedances	
				MAC	1/2 MAC
Atrazine + N-dealkylated metabolites (ug/L) - TW	2025/08/05	<MDL 0.01	5.00	No	No
Azinphos-methyl (ug/L) - TW	2025/08/05	<MDL 0.05	20.00	No	No
Benzene (ug/L) - TW	2025/08/05	<MDL 0.32	1.00	No	No
Benzo(a)pyrene (ug/L) - TW	2025/08/05	<MDL 0.004	0.01	No	No
Bromoxynil (ug/L) - TW	2025/08/05	<MDL 0.33	5.00	No	No
Carbaryl (ug/L) - TW	2025/08/05	<MDL 0.05	90.00	No	No
Carbofuran (ug/L) - TW	2025/08/05	<MDL 0.01	90.00	No	No
Carbon Tetrachloride (ug/L) - TW	2025/08/05	<MDL 0.17	2.00	No	No
Chlorpyrifos (ug/L) - TW	2025/08/05	<MDL 0.02	90.00	No	No
Diazinon (ug/L) - TW	2025/08/05	<MDL 0.02	20.00	No	No
Dicamba (ug/L) - TW	2025/08/05	<MDL 0.2	120.00	No	No
1,2-Dichlorobenzene (ug/L) - TW	2025/08/05	<MDL 0.41	200.00	No	No
1,4-Dichlorobenzene (ug/L) - TW	2025/08/05	<MDL 0.36	5.00	No	No
1,2-Dichloroethane (ug/L) - TW	2025/08/05	<MDL 0.35	5.00	No	No
1,1-Dichloroethylene (ug/L) - TW	2025/08/05	<MDL 0.33	14.00	No	No
Dichloromethane (Methylene Chloride) (ug/L) - TW	2025/08/05	<MDL 0.35	50.00	No	No
2,4-Dichlorophenol (ug/L) - TW	2025/08/05	<MDL 0.15	900.00	No	No
2,4-Dichlorophenoxy acetic acid (2,4-D) (ug/L) - TW	2025/08/05	<MDL 0.19	100.00	No	No
Diclofop-methyl (ug/L) - TW	2025/08/05	<MDL 0.4	9.00	No	No
Dimethoate (ug/L) - TW	2025/08/05	<MDL 0.06	20.00	No	No
Diquat (ug/L) - TW	2025/08/05	<MDL 1.0	70.00	No	No
Diuron (ug/L) - TW	2025/08/05	<MDL 0.03	150.00	No	No
Glyphosate (ug/L) - TW	2025/08/05	<MDL 1.0	280.00	No	No
Malathion (ug/L) - TW	2025/08/05	<MDL 0.02	190.00	No	No
Metolachlor (ug/L) - TW	2025/08/05	<MDL 0.01	50.00	No	No
Metribuzin (ug/L) - TW	2025/08/05	<MDL 0.02	80.00	No	No
Monochlorobenzene (Chlorobenzene) (ug/L) - TW	2025/08/05	<MDL 0.3	80.00	No	No
Paraquat (ug/L) - TW	2025/08/05	<MDL 1.0	10.00	No	No
PCB (ug/L) - TW	2025/08/05	<MDL 0.04	3.00	No	No
Pentachlorophenol (ug/L) - TW	2025/08/05	<MDL 0.15	60.00	No	No
Phorate (ug/L) - TW	2025/08/05	<MDL 0.01	2.00	No	No
Picloram (ug/L) - TW	2025/08/05	<MDL 1.0	190.00	No	No
Prometryne (ug/L) - TW	2025/08/05	<MDL 0.03	1.00	No	No
Simazine (ug/L) - TW	2025/08/05	<MDL 0.01	10.00	No	No
Terbufos (ug/L) - TW	2025/08/05	<MDL 0.01	1.00	No	No
Tetrachloroethylene (ug/L) - TW	2025/08/05	<MDL 0.35	10.00	No	No
2,3,4,6-Tetrachlorophenol (ug/L) - TW	2025/08/05	<MDL 0.2	100.00	No	No

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Exceedances	
				MAC	1/2 MAC
Triallate (ug/L) - TW	2025/08/05	<MDL 0.01	230.00	No	No
Trichloroethylene (ug/L) - TW	2025/08/05	<MDL 0.44	5.00	No	No
2,4,6-Trichlorophenol (ug/L) - TW	2025/08/05	<MDL 0.25	5.00	No	No
2-Methyl-4chlorophenoxyacetic Acid (MCPA) (ug/L)	2025/08/05	<MDL 0.12	100	No	No
Trifluralin (ug/L) - TW	2025/08/05	<MDL 0.02	45.00	No	No
Vinyl Chloride (ug/L) - TW	2025/08/05	<MDL 0.17	1.00	No	No
Distribution Water					
Trihalomethane: Total (ug/L) Annual Average - DW	2025	37.0	100	No	Yes
HAA Total (ug/L) Annual Average - DW	2025	21.13	80	No	Yes

MAC = Maximum Allowable Concentration as per O. Reg. 169/03

MDL = Method Detection Limit

Additional Legislated Samples

Municipal Drinking Water License (MDWL)	Date Sampled	Total Suspended Solids Result (mg/L)	Total Chlorine Residual Result (mg/L)
Settling Tank Discharge Point	January 2025	3	0.00
	February 2025	2	0.00
	March 2025	12	0.00
	April 2025	14	0.00
	May 2025	25	0.00
	June 2025	46	0.00
	July 2025	7	0.00
	August 2025	4	0.00
	September 2025	67	0.00
	October 2025	3	0.00
	November 2025	4	0.00
	December 2025	4	0.00
Annual Average	2025 Annual Average	15.91	0.00

Note: The Suspended Solids annual average limit is 25 mg/L.

Note: The Total Chlorine Residual annual average limit is 0.02 mg/L. (Total chlorine sampling requirement came into effect February 2024).

Municipal Drinking Water Licence (MDWL)	Parameter	Date Sampled	Result	Unit of Measure
Settling Tank Discharge Pont	Filter Backwash (FBW): pH	February 2025	7.95	No unit
	Filter Backwash (FBW): Aluminum	February 2025	0.201	mg/L

Municipal Drinking Water Licence (MDWL)	Collected Weekly June – Oct 2024	Total Microcystin Raw Results Range (ug/L)	Total Microcystin Treated Water Results Range (ug/L)	Treated Water Total Microcystin Limit 1.5 ug/L Exceeded Y/N
Harmful Algal Blooms Monitoring required June to October at a minimum. Samples collected weekly. Raw water tested for Total Microcystins.	June	<0.1 – <0.1	-	N
	July	<0.1 - <0.1	-	N
	August	<0.1 - <0.1	-	N
	September	<0.1 - <0.1	-	N
	October	<0.1 – <0.1	-	N

Method Detection Limit is 0.1ug/L

* Treated water is only sampled if microcystins detected in the raw water sample.

Inorganic or Organic Parameter Exceedances

List any Inorganic or Organic parameter(s) that exceeded half the standard prescribed in Schedule 2 of Ontario Drinking Water Quality Standards.

Parameter	Result Value	Unit of Measure	Date of Sample
Trihalomethane: Total (ug/L) Annual Average - DW	37.0	(ug/L)	2025 Annual Average
HAA Total (ug/L) Annual Average - DW	21.13	(ug/L)	2025 Annual Average

6. Major Maintenance Summary incurred to install, repair or replace required equipment.

Item #	Description
1	Treated megameter failed and replaced under warranty
2	Treated flow meter replacement

3	Clean backwash settling tanks
4	Replaced HLP VFD cooling fans

APPENDIX A

WTRS DATA SUBMISSION

CONFIRMATION

WTRS Data Submission Confirmation

Ontario  **Regulatory Self-Reporting System** Ministry of the Environment, Conservation and Parks

Client Name: CORPORATION OF THE TOWNSHIP OF RAMARA **Reporting Year:** 2025 **Service:** PTTW **Permit Number:** P-300-1030655871 **Permit Version:** 1.0 **New or Updated Submission:** UPDATED

Site Name: South Ramara Drinking Water System

Source ID: 50000789667 **Source Name:** Lake Simcoe **Source Type:** Lake

UTM (Zone/Easting/Northing): 17/643528.0/4927529.0 **Method of Determination:** Metered **Unit of Measure:** Litre

Description: Lake Simcoe **Purpose Category:** Other services (except public administration) **Specific Category:** Municipal Supply **Activity:** Water Supply

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
1	48000.0	33000.0	49000.0	94000.0	46000.0	65000.0	85000.0	137000.0	72000.0	32000.0	33000.0	32000.0
2	61000.0	48000.0	47000.0	43000.0	80000.0	51000.0	91000.0	178000.0	73000.0	49000.0	34000.0	32000.0
3	31000.0	38000.0	39000.0	52000.0	41000.0	48000.0	68000.0	145000.0	34000.0	73000.0	43000.0	31000.0
4	47000.0	65000.0	59000.0	69000.0	58000.0	54000.0	101000.0	148000.0	45000.0	51000.0	32000.0	45000.0
5	46000.0	30000.0	32000.0	52000.0	29000.0	48000.0	102000.0	73000.0	63000.0	49000.0	32000.0	62000.0
6	57000.0	26000.0	44000.0	50000.0	50000.0	94000.0	79000.0	55000.0	50000.0	34000.0	67000.0	31000.0
7	24000.0	60000.0	92000.0	63000.0	47000.0	67000.0	67000.0	63000.0	49000.0	44000.0	31000.0	47000.0
8	45000.0	46000.0	48000.0	48000.0	32000.0	73000.0	74000.0	88000.0	69000.0	71000.0	46000.0	29000.0
9	45000.0	46000.0	32000.0	47000.0	78000.0	56000.0	71000.0	90000.0	92000.0	33000.0	48000.0	33000.0
10	56000.0	47000.0	53000.0	79000.0	72000.0	43000.0	80000.0	91000.0	31000.0	82000.0	67000.0	44000.0
11	46000.0	45000.0	32000.0	64000.0	49000.0	55000.0	119000.0	73000.0	70000.0	52000.0	31000.0	30000.0
12	47000.0	31000.0	47000.0	49000.0	49000.0	67000.0	85000.0	91000.0	62000.0	53000.0	46000.0	58000.0
13	33000.0	44000.0	68000.0	48000.0	49000.0	65000.0	118000.0	67000.0	49000.0	50000.0	31000.0	32000.0
14	30000.0	62000.0	31000.0	50000.0	50000.0	75000.0	125000.0	71000.0	69000.0	86000.0	64000.0	46000.0
15	64000.0	49000.0	66000.0	63000.0	44000.0	91000.0	123000.0	162000.0	57000.0	34000.0	47000.0	28000.0
16	32000.0	49000.0	116000.0	37000.0	86000.0	57000.0	75000.0	174000.0	68000.0	47000.0	14000.0	32000.0
17	32000.0	48000.0	39000.0	66000.0	88000.0	99000.0	101000.0	113000.0	77000.0	66000.0	66000.0	46000.0
18	46000.0	58000.0	62000.0	53000.0	76000.0	51000.0	118000.0	67000.0	67000.0	50000.0	32000.0	60000.0
19	48000.0	38000.0	64000.0	50000.0	95000.0	49000.0	99000.0	34000.0	87000.0	52000.0	42000.0	28000.0
20	60000.0	32000.0	33000.0	50000.0	54000.0	54000.0	107000.0	52000.0	91000.0	34000.0	61000.0	48000.0
21	32000.0	64000.0	32000.0	33000.0	75000.0	78000.0	137000.0	55000.0	73000.0	46000.0	31000.0	69000.0
22	35000.0	46000.0	49000.0	65000.0	49000.0	77000.0	80000.0	92000.0	80000.0	32000.0	46000.0	67000.0
23	35000.0	41000.0	48000.0	32000.0	49000.0	96000.0	92000.0	71000.0	48000.0	43000.0	49000.0	66000.0
24	43000.0	70000.0	34000.0	46000.0	58000.0	51000.0	96000.0	100000.0	39000.0	75000.0	35000.0	60000.0
25	47000.0	32000.0	65000.0	43000.0	78000.0	70000.0	125000.0	73000.0	42000.0	91000.0	31000.0	47000.0
26	32000.0	39000.0	31000.0	34000.0	80000.0	50000.0	100000.0	70000.0	70000.0	76000.0	31000.0	46000.0
27	70000.0	32000.0	46000.0	50000.0	49000.0	93000.0	73000.0	68000.0	49000.0	54000.0	32000.0	32000.0
28	47000.0	59000.0	32000.0	40000.0	51000.0	68000.0	87000.0	52000.0	64000.0	31000.0	62000.0	47000.0
29	31000.0		38000.0	67000.0	50000.0	80000.0	52000.0	90000.0	64000.0	47000.0	34000.0	44000.0
30	31000.0		168000.0	35000.0	83000.0	92000.0	66000.0	75000.0	47000.0	61000.0	67000.0	61000.0
31	64000.0		189000.0		67000.0		54000.0	76000.0		43000.0		34000.0

Name of Attester

First Name: Natalie

Last Name: Lamiot

Company: Ontario Clean Water Agency

Date Certified/Submitted (yyy/mm/dd): 2026/02/13