

WTP-105 DRINKING WATER SYSTEM WATERWORKS # 220010690

LIMITED SYSTEM

ANNUAL WATER REPORT

PREPARED FOR
The Township of Ramara

SUBMITTED BY
Ontario Clean Water Agency
2085 Hurontario Street, Suite 500
Mississauga, ON L5A 4G1

Reporting Period: January 1 – December 31, 2025

Issued: February 13, 2026

Revision: 0

Operating Authority: Ontario Clean Water Agency (OCWA)

This report has been prepared to satisfy the annual reporting requirements in O. Reg. 170/03 Section 11 and Schedule 22

Table of Contents

1. Report Availability	1
2. Compliance Report Card.....	1
3. System Process Description	1
Raw Source.....	1
Treatment	2
Treatment Chemicals used during the reporting year:	2
4. Summary of Non-Compliance	2
Adverse Water Quality Incidents	2
Non-Compliance.....	2
Non-Compliance Identified in a Ministry of the Environment Conservation and Parks Inspection	2
Community Complaints.....	2
Flows	2
Raw Water Flows	2
Total Monthly Flows (m ³ /d)-Well #1.....	3
Monthly Rated Flows (L/s)-Well #1	3
Total Monthly Flows (m ³ /d)-Well #2.....	4
Monthly Rated Flows (L/s)-Well #2	4
Total Monthly Flows- (m ³ /d)-Well #3R.....	5
Monthly Rated Flows (L/s)-Well #3R.....	5
Treated Water Flows.....	6
System Reserve Capacity.....	7
Monthly Rated Flows	7
Annual Total Flow Comparison	7
5. Regulatory Sample Results Summary.....	8
Microbiological Testing	8
Operational Testing.....	8
Inorganic Parameters	9
Schedule 15 Sampling:	9
Organic Parameters.....	10

Additional Legislated Samples..... 11

Inorganic or Organic Parameter Exceedances 11

6. Major Maintenance Summary incurred to install, repair or replace required equipment.....Er

ror! Bookmark not defined.2

Appendix A – WTRS Data Submission Confirmation

1. Report Availability

This system does not serve more than 10,000 residence and the annual reports will be available to residents at the Township of Ramara Administration Office and on the Township’s website at www.ramara.ca. Notification that reports are available free of charge will be made on the Township of Ramara website. The Township of Ramara Administration Office is located at 2297 Highway 12, Brechin, ON L0K 1B0.

2. Compliance Report Card

Drinking Water System Number: 220010690

Drinking Water System Name: WTP-105 (Val Harbour DWS)

Drinking Water System Owner: Township of Ramara

Drinking Water System Category: Small Municipal Residential

Period Being Reported: January 1, 2025 - December 31, 2025

Health & Safety	# of Events	Date	Details
Number of Incidents	0	N/A	N/A

Drinking Water	# of Events	Date	Details
Ministry of the Environment Conservation and Parks (MECP) Inspections	1	November 4, 2025	Unannounced Focused Drinking Water Inspection completed for 2025 inspection cycle. Final rating received – 100%
AWQI	1	August 8, 2025	AWQI 169369 - Treated Water High Sodium Result
Number of Non-Compliances	0	N/A	N/A
Number of Boil Water Advisories	0	N/A	N/A

3. System Process Description

Raw Source

The Val Harbour DWS is supplied with raw groundwater from three non-GUDI wells: Well # 1, Well # 2 and Well # 3R.

Treatment

The treatment system consists of the following:

- Sodium hypochlorite primary disinfection system
- Two (2) below grade reservoirs for potable water storage
- A high lift pumping system
- Stand-by propane generator on-site

Treatment Chemicals used during the reporting year:

Chemical Name	Use	Supplier
Sodium Hypochlorite	Disinfection	Brenntag

4. Summary of Non-Compliance

Adverse Water Quality Incidents

Date	AWQI #	Location	Details	Legislation	Corrective Action Taken
August 8, 2025	169369	Treated Water	High Sodium Result of 23.9 mg/L	O. Reg 170/03	Re-sampled TW on August 11, 2025 result = 24.2 mg/L. Sodium Notices made public through the Township of Ramara.

Non-Compliance

Legislation	Requirement(s) system failed to meet	Duration of the failure (i.e. date(s))	Corrective Action	Status
There were no non-compliance issues reported during the reporting period.				

Non-Compliance Identified in a Ministry of the Environment Conservation of Parks Inspection:

Legislation	Requirement(s) system failed to meet	Duration of the failure (i.e. date(s))	Corrective Action	Status
There were no non-compliances identified in a Ministry of the Environment Conservation and Parks Inspection during the reporting period.				

Community Complaints

Date	Details of Complaint	Actions Taken
May 24, 2025	Customer left voicemail with township saying showers are causing red hives from the water.	Left voicemail with customer and did not receive a call back.
July 2, 2025	Water Supply Taste/Colour – chlorine odour when contractors on site	Informed customer the work being performed by contractors does not affect the operation of the plant and to flush cold water if experiencing the odour.

Flows


The Val Harbour Drinking Water System is operating on average under half the rated capacity.

Raw Water Flows

The Permit to Take Water compliance criteria is in litres per minute (L/min) but for the purposes of this report the flow rate is reported in litres per second (L/sec) based on industry standard for flow monitoring recording. The Raw Water flows are regulated under the Permit to Take Water. 2025 Raw Flow Data was submitted to the Ministry of the Environment Conservation and Parks electronically under permit No. P-300-9104539203. The confirmation and a copy of the data that was submitted are attached in Appendix A.


Total Monthly Flows (m³/d)

Max Allowable PTTW – Well # 1

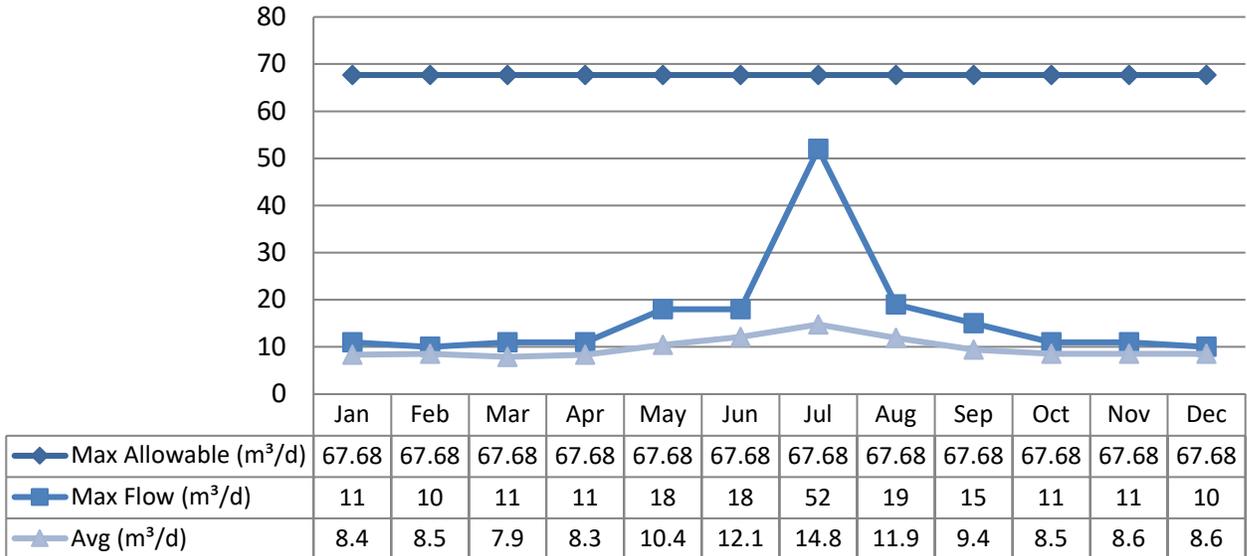


Monthly Rated Flows (L/s)

Max Allowable Rate – PTTW – Well # 1

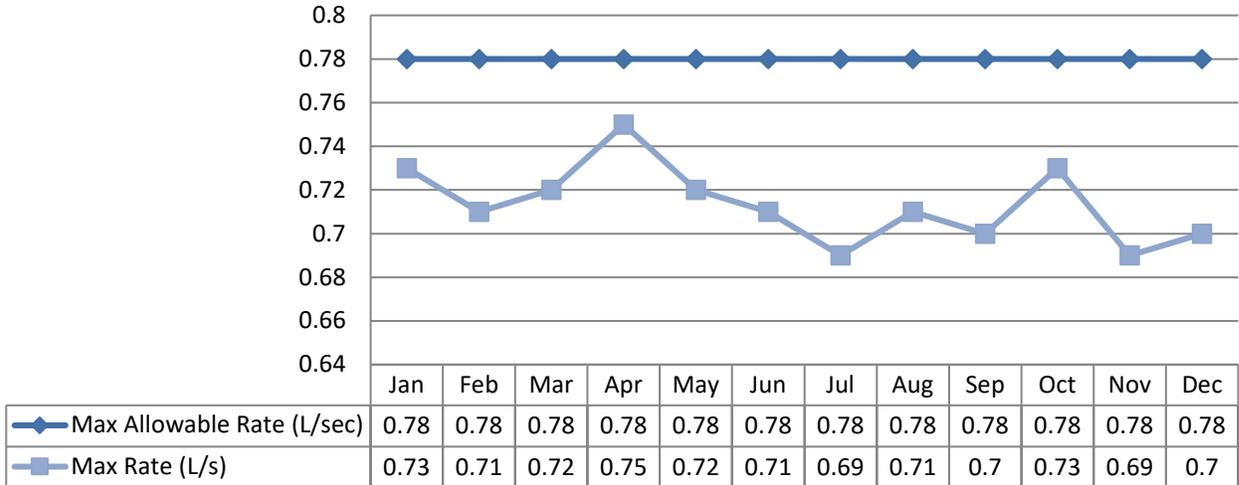


Total Monthly Flows (m³/d)

Max Allowable PTTW – Well # 2

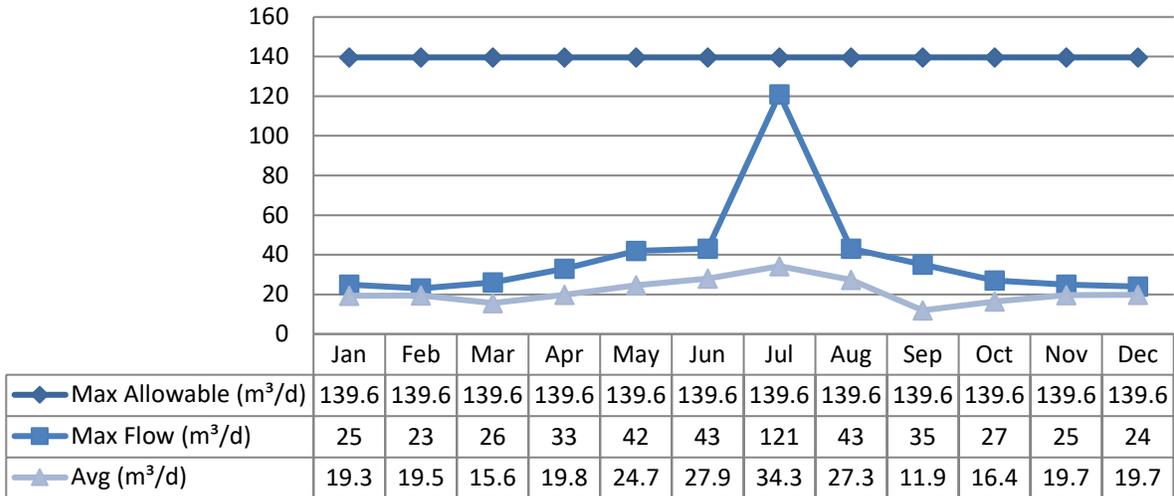


Monthly Rated Flows (L/s)

Max Allowable Rate – PTTW – Well # 2

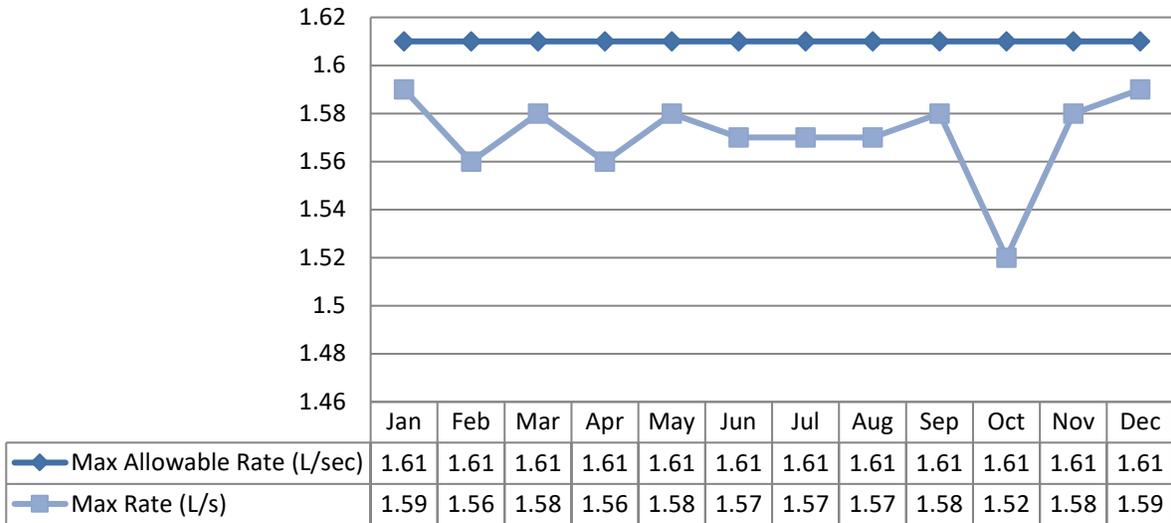

Total Monthly Flows (m³/d)


Max Allowable PTTW – Well # 3R

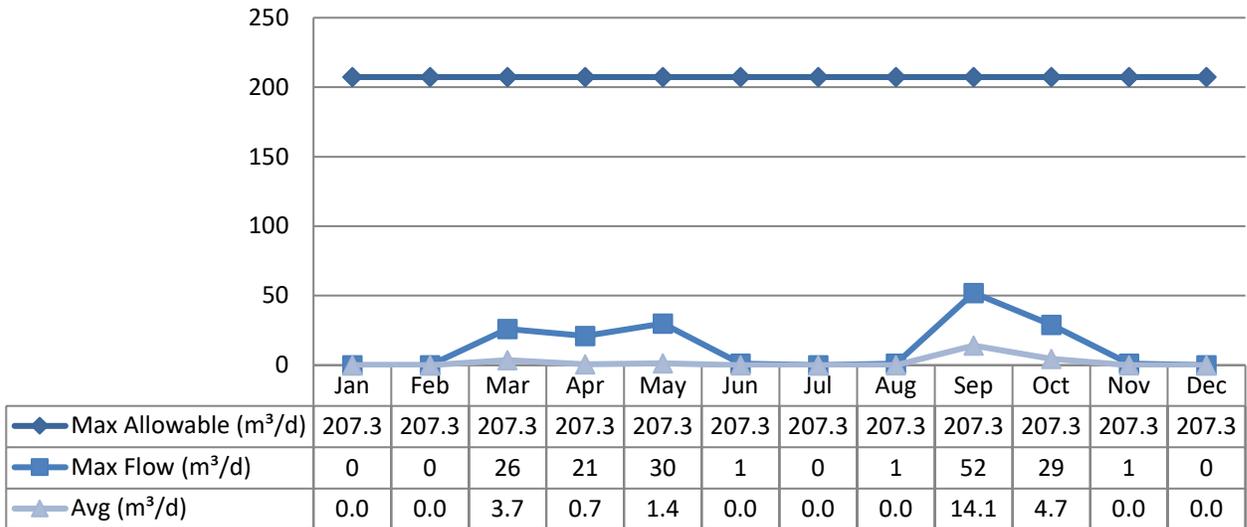

Note: Well # 3R not in production from June through December other than for sampling purposes.

Monthly Rated Flows (L/s)

Max Allowable Rate – PTTW – Well # 3R

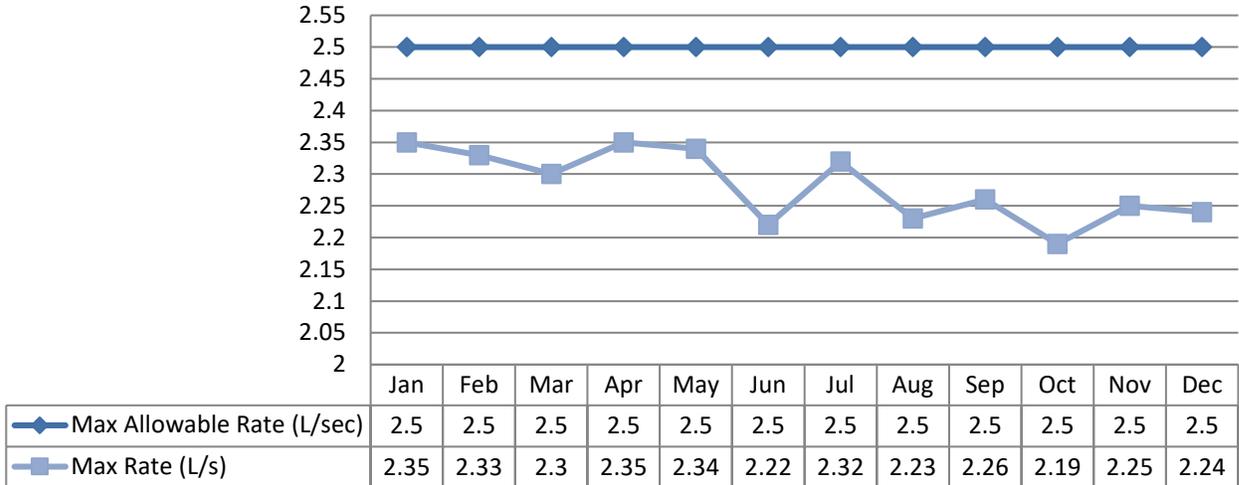

Note: Well # 3R not in production from June through December other than for sampling purposes.

Treated Water Flows

The Treated Water flows are regulated under the Municipal Licence. The average water consumption for the Val Harbour Drinking Water System during 2025 was: 37 m³/day.

Val Harbour Drinking Water System Historical Demands

Year	Number of Connections	Average Daily Demand (m ³)	Maximum Daily Demand (m ³ /day)	Rated Capacity	Per Capita Consumption* (L/p/day)	
					Average	Maximum
2015	63	31	63	207	190	385
2016	63	32	74	207	195	452
2017	64	30	64	207	182	385
2018	64	37	89	207	224	536
2019	65	31	55	207	186	325
2020	66	35	81	207	207	479
2021	66	39	80	207	231	473
2022	69	34	71	207	198	396
2023	70	37	74	207	203	407
2024	70	39	70	207	214	385
2025	70	37	72	207	203	396
3 Year Average/Max		38	72	207	207	396

*Based on 2.6 people per dwelling

Note: Excluding pipe leaks/breaks & system flushing

Note: This calculation was completed based on current connections in the system, growth within the drinking water system has not been considered.

System Reserve Capacity

In accordance with the MECP Procedure D-5-1, the reserve capacity is calculated by the following formula:

$$\text{Reserve Capacity} = \text{Design Flow} - \text{Committed Flow}$$


Design flow is the maximum permissible flow approved by the MDWL and/or PTTW. Val Harbour Water Works maximum daily rated capacity is 207 m³/day.

The committed flow is the total expected water demand from the existing and proposed connections based on the previous three years of data. The committed number of service connections is: 74. The three-year (2023-2025) maximum per capita water consumption is: 396 L/p/day. At this water consumption rate, the committed flow is: 76 m³/day.

As a result, the calculated reserve capacity is: 131 m³/day.


Monthly Rated Flows

Rated Capacity – MDWL

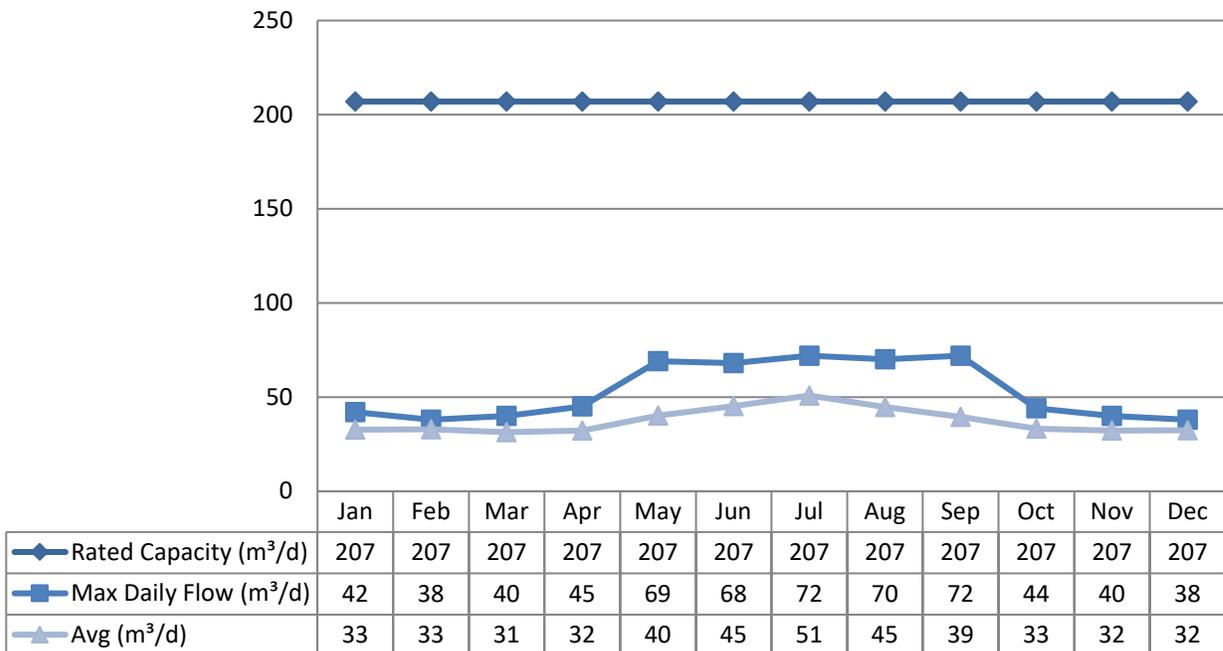

Annual Total Flow Comparison

Total Annual m³

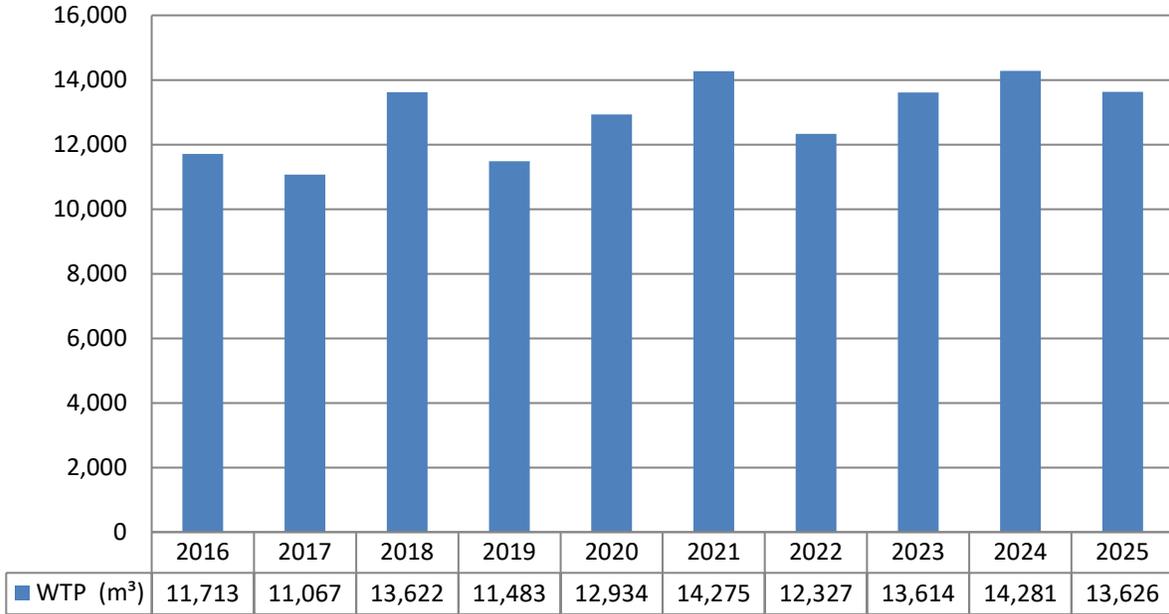

5. Regulatory Sample Results Summary

Microbiological Testing

	No. of Samples Collected	Range of E. Coli Results		Range of Total Coliform Results		Range of HPC Results	
		Min	Max	Min	Max	Min	Max
Raw Well 1	12	0	0	0	0		
Raw Well 2	12	0	0	0	0		
Raw Well 3R	12	0	0	0	6		
Distribution	26	0	0	0	0	0	1

Operational Testing

	No. of Samples Collected	Range of Results	
		Minimum	Maximum
Turbidity Well 1 (NTU)	12	0.08	0.42
Turbidity Well 2 (NTU)	12	0.13	0.52
Turbidity Well 3R (NTU)	12	0.15	5.07
Turbidity – Treated Water (NTU)	8760	0.06	2.08
Treated Water Chlorine	8760	0.25	2.93
Distribution Water Chlorine	105	0.32	1.62
Fluoride (If the DWS provides fluoridation)	N/A	N/A	N/A

Note: Record the unit of measure if it is **not** milligrams per liter.

Note: For continuous monitors 8760 is used as the number of samples. Spikes recorded by on-line instrumentation were a result of air bubbles and various maintenance/calibration activities. All spikes are reviewed for compliance with O. Reg. 170/03.

Inorganic Parameters

These parameters are tested as a requirement under O. Reg. 170/03. Sodium and Fluoride are required to be tested every 5 years. Nitrate and Nitrite are tested quarterly and the metals are tested every 5 years as required under O. Reg. 170/03. In the event any of the parameters exceed half of the maximum allowable concentration the parameter is required to be sampled quarterly.

- MAC = Maximum Allowable Concentration as per O. Reg. 169/03
- MDL = Method Detection Limit

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Exceedances	
				MAC	1/2 MAC
Treated Water					
Antimony: Sb (ug/L) - TW	2024/08/07	<MDL 0.6	6.0	No	No
Arsenic: As (ug/L) - TW	2024/08/07	<MDL 0.2	10.0	No	No
Barium: Ba (ug/L) - TW	2024/08/07	115	1000.0	No	No
Boron: B (ug/L) - TW	2024/08/07	59	5000.0	No	No
Cadmium: Cd (ug/L) - TW	2024/08/07	0.005	5.0	No	No
Chromium: Cr (ug/L) - TW	2024/08/07	0.27	50.0	No	No
Mercury: Hg (ug/L) - TW	2024/08/07	<MDL 0.01	1.0	No	No
Selenium: Se (ug/L) - TW	2024/08/07	0.06	50.0	No	No
Uranium: U (ug/L) - TW	2024/08/07	0.331	20.0	No	No
Additional Inorganics					
Fluoride (mg/L) - TW	2022/08/04	0.13	1.5	No	No
Nitrite (mg/L) - TW	2025/02/04	<MDL 0.003	1.0	No	No
Nitrite (mg/L) - TW	2025/05/05	0.012	1.0	No	No
Nitrite (mg/L) - TW	2025/08/05	<MDL 0.003	1.0	No	No
Nitrite (mg/L) - TW	2025/11/03	<MDL 0.003	1.0	No	No
Nitrate (mg/L) - TW	2025/02/04	2.45	10.0	No	No
Nitrate (mg/L) - TW	2025/05/05	2.31	10.0	No	No
Nitrate (mg/L) - TW	2025/08/05	1.37	10.0	No	No
Nitrate (mg/L) - TW	2025/11/03	1.02	10.0	No	No
Sodium: Na (mg/L) - TW	2025/08/05	23.9	20*	N/A	N/A
Sodium: Na (mg/L) - TW	2025/08/11	24.2	20*	N/A	N/A

*There is no "MAC" for Sodium. The aesthetic objective for sodium in drinking water is 200 mg/L. The local Medical Officer of Health should be notified when the sodium concentration exceeds 20 mg/L so that this information may be communicated to local physicians for their use with patients on sodium restricted diets.

Schedule 15 Sampling

The Schedule 15 Sampling is required under O. Reg. 170/03. This system is under reduced sampling. No plumbing samples were collected.

Distribution System	No. of Samples	Range of Results Minimum	Range of Results Maximum	MAC (ug/L)	No. of Exceedances
Alkalinity (mg/L)	2	259	265	N/A	N/A
pH	2	7.37	8.10	N/A	N/A
Lead (ug/l)	2	0.09	0.47	10	0

Note: Lead is required to be sampled every 3 years and is scheduled to be sampled in 2028.

Organic Parameters

These parameters are tested every 5 years as a requirement under O. Reg 170/03. In the event any of the parameters exceed half of the maximum allowable concentration the parameter is required to be sampled quarterly.

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Exceedances	
				MAC	1/2 MAC
Treated Water					
Alachlor (ug/L) - TW	2024/08/07	<MDL 0.02	5.00	No	No
Atrazine + N-dealkylated metabolites (ug/L) - TW	2024/08/07	<MDL 0.01	5.00	No	No
Azinphos-methyl (ug/L) - TW	2024/08/07	<MDL 0.05	20.00	No	No
Benzene (ug/L) - TW	2024/08/07	<MDL 0.32	1.00	No	No
Benzo(a)pyrene (ug/L) - TW	2024/08/07	<MDL 0.004	0.01	No	No
Bromoxynil (ug/L) - TW	2024/08/07	<MDL 0.33	5.00	No	No
Carbaryl (ug/L) - TW	2024/08/07	<MDL 0.05	90.00	No	No
Carbofuran (ug/L) - TW	2024/08/07	<MDL 0.01	90.00	No	No
Carbon Tetrachloride (ug/L) - TW	2024/08/07	<MDL 0.17	2.00	No	No
Chlorpyrifos (ug/L) - TW	2024/08/07	<MDL 0.02	90.00	No	No
Diazinon (ug/L) - TW	2024/08/07	<MDL 0.02	20.00	No	No
Dicamba (ug/L) - TW	2024/08/07	<MDL 0.20	120.00	No	No
1,2-Dichlorobenzene (ug/L) - TW	2024/08/07	<MDL 0.41	200.00	No	No
1,4-Dichlorobenzene (ug/L) - TW	2024/08/07	<MDL 0.36	5.00	No	No
1,2-Dichloroethane (ug/L) - TW	2024/08/07	<MDL 0.35	5.00	No	No
1,1-Dichloroethylene (ug/L) - TW	2024/08/07	<MDL 0.33	14.00	No	No
Dichloromethane (Methylene Chloride) (ug/L) - TW	2024/08/07	<MDL 0.35	50.00	No	No
2,4-Dichlorophenol (ug/L) - TW	2024/08/07	<MDL 0.15	900.00	No	No
2,4-Dichlorophenoxy acetic acid (2,4-D) (ug/L) - TW	2024/08/07	<MDL 0.19	100.00	No	No
Diclofop-methyl (ug/L) - TW	2024/08/07	<MDL 0.4	9.00	No	No
Dimethoate (ug/L) - TW	2024/08/07	<MDL 0.06	20.00	No	No
Diquat (ug/L) - TW	2024/08/07	<MDL 1.0	70.00	No	No
Diuron (ug/L) - TW	2024/08/07	<MDL 0.03	150.00	No	No
Glyphosate (ug/L) - TW	2024/08/07	<MDL 1.0	280.00	No	No

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Exceedances	
				MAC	1/2 MAC
Malathion (ug/L) - TW	2024/08/07	<MDL 0.02	190.00	No	No
2-Methyl-4chlorophenoxyacetic Acid (MCPA) (ug/L)	2024/08/07	<MDL 0.12	100	No	No
Metolachlor (ug/L) - TW	2024/08/07	<MDL 0.01	50.00	No	No
Metribuzin (ug/L) - TW	2024/08/07	<MDL 0.02	80.00	No	No
Monochlorobenzene (Chlorobenzene) (ug/L) - TW	2024/08/07	<MDL 0.3	80.00	No	No
Paraquat (ug/L) - TW	2024/08/07	<MDL 1.0	10.00	No	No
PCB (ug/L) - TW	2024/08/07	<MDL 0.04	3.00	No	No
Pentachlorophenol (ug/L) - TW	2024/08/07	<MDL 0.15	60.00	No	No
Phorate (ug/L) - TW	2024/08/07	<MDL 0.01	2.00	No	No
Picloram (ug/L) - TW	2024/08/07	<MDL 1.0	190.00	No	No
Prometryne (ug/L) - TW	2024/08/07	<MDL 0.03	1.00	No	No
Simazine (ug/L) - TW	2024/08/07	<MDL 0.01	10.00	No	No
Terbufos (ug/L) - TW	2024/08/07	<MDL 0.01	1.00	No	No
Tetrachloroethylene (ug/L) - TW	2024/08/07	<MDL 0.35	10.00	No	No
2,3,4,6-Tetrachlorophenol (ug/L) - TW	2024/08/07	<MDL 0.2	100.00	No	No
Triallate (ug/L) - TW	2024/08/07	<MDL 0.01	230.00	No	No
Trichloroethylene (ug/L) - TW	2024/08/07	<MDL 0.44	5.00	No	No
2,4,6-Trichlorophenol (ug/L) - TW	2024/08/07	<MDL 0.25	5.00	No	No
Trifluralin (ug/L) - TW	2024/08/07	<MDL 0.02	45.00	No	No
Vinyl Chloride (ug/L) - TW	2024/08/07	<MDL 0.17	1.00	No	No
Distribution Water					
Trihalomethane: Total (ug/L) Annual Average - DW	2025	14.5	100	No	No
HAA Total (ug/L) Annual Average - DW	2025	10.9	80	No	No

MAC = Maximum Allowable Concentration as per O. Reg. 169/03

MDL = Method Detection Limit

Additional Legislated Samples

Date of Legal Instrument Issued	Parameter	Date Sampled	Result	Unit of Measure
No additional legislated samples required.				

Inorganic or Organic Parameter Exceedances

List any Inorganic or Organic parameter(s) that exceeded half the standard prescribed in Schedule 2 of Ontario Drinking Water Quality Standards.


Parameter	Result Value	Unit of Measure	Date of Sample
No exceedances.			

6. Major Maintenance Summary

Item #	Description
1	Well #3 piping leak repaired
2	New HLP and vacuum priming pump commissioned
3	PLC power supply replaced
4	Chlorine level sensor replaced

Appendix A

WTRS Submission Confirmation

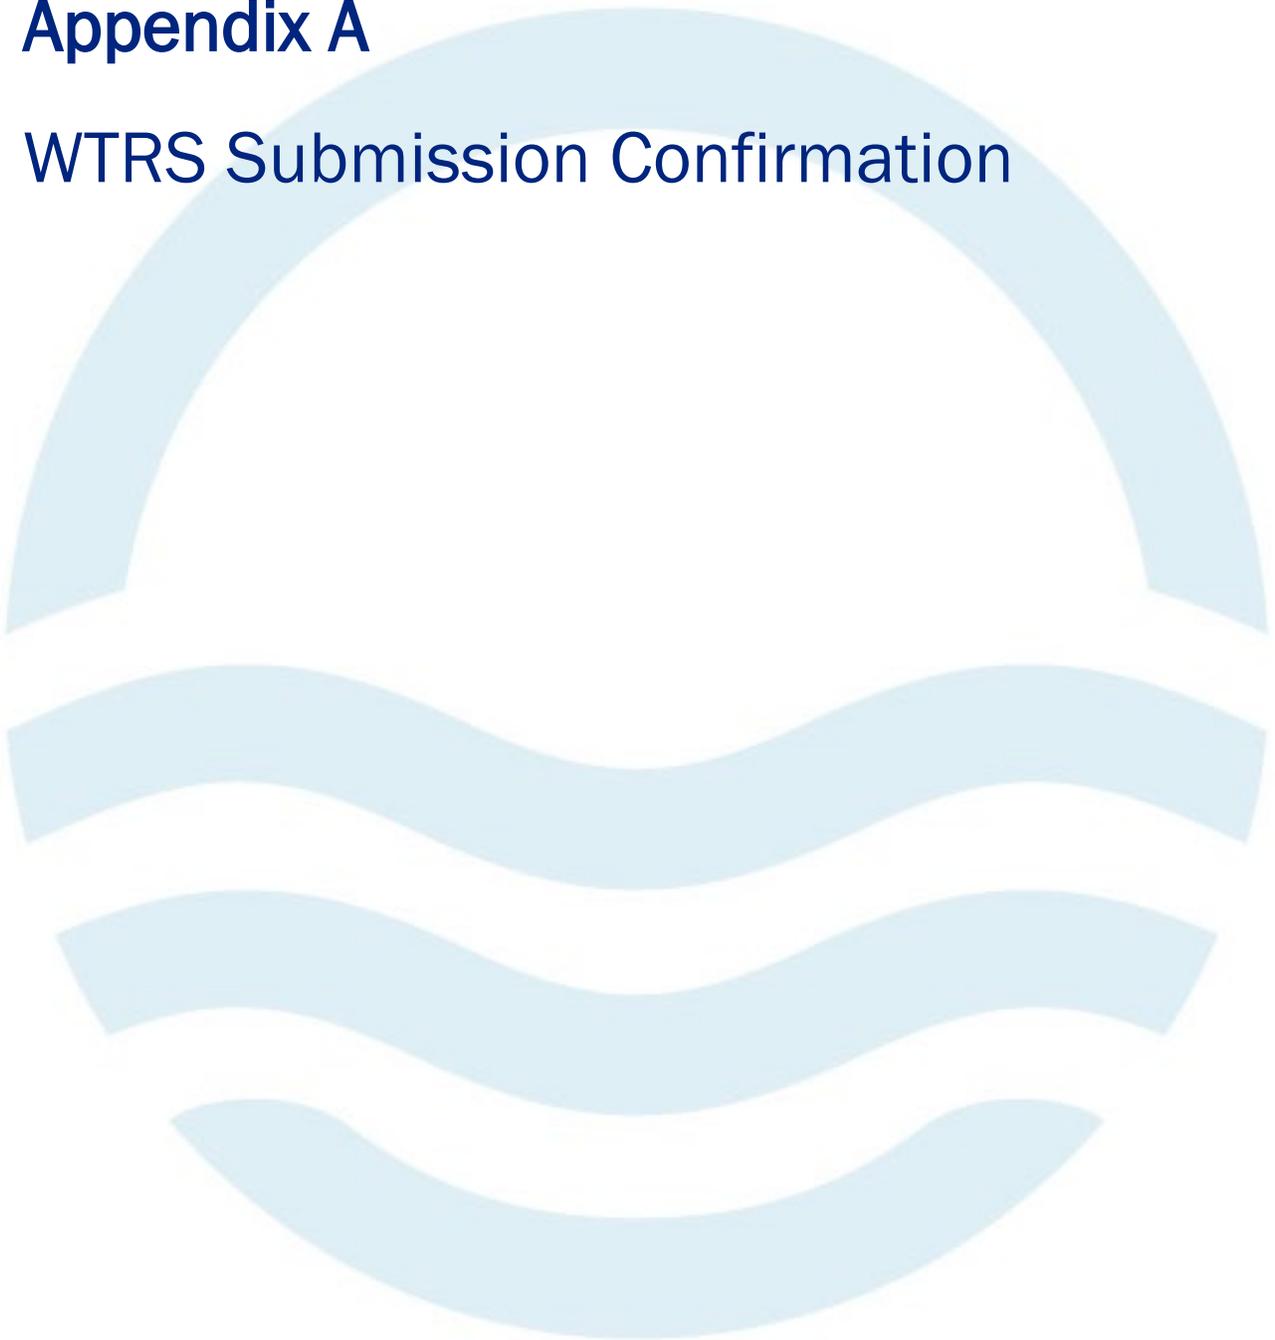

WTRS Submission Confirmation

Ontario  Regulatory Self-Reporting System Ministry of the Environment, Conservation and Parks

Client Name: CORPORATION OF THE TOWNSHIP OF RAMARA Reporting Year: 2025 Service: PTTW Permit Number: P-300-9104539203 Permit Version: 1.0 New or Updated Submission: NEW

Site Name: Val Harbour Subdivision Drinking Water System

Source ID: 500000549102 Source Name: Lake Simcoe Source Type: Well

UTM(Zone/Easting/Northing): 17/835140.0/4938050.0 Method of Determination: Metered Unit of Measure: Litre

Description: Well #1 Purpose Category: Public administration Specific Category: Municipal Supply Activity: Water Supply

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
1	9000.0	9000.0		7000.0	8000.0	12000.0	11000.0	14000.0	15000.0	8000.0	10000.0	8000.0
2	7000.0	9000.0		5000.0	9000.0	11000.0	15000.0	14000.0	9000.0	7000.0	11000.0	8000.0
3	10000.0	9000.0		10000.0	10000.0	9000.0	9000.0	19000.0	10000.0	7000.0	9000.0	8000.0
4	10000.0	9000.0		6000.0	12000.0	12000.0	17000.0	17000.0	8000.0	9000.0	8000.0	8000.0
5	10000.0	8000.0		5000.0	11000.0	8000.0	15000.0	11000.0	9000.0	9000.0	8000.0	6000.0
6	7000.0	8000.0		9000.0	8000.0	10000.0	15000.0	15000.0	9000.0	9000.0	9000.0	10000.0
7	8000.0	9000.0		11000.0	7000.0	12000.0	10000.0	12000.0	12000.0	9000.0	8000.0	9000.0
8	4000.0	9000.0		8000.0	9000.0	13000.0	13000.0	12000.0	10000.0	10000.0	9000.0	8000.0
9	8000.0	10000.0		10000.0	9000.0	11000.0	9000.0	11000.0	12000.0	9000.0	9000.0	7000.0
10	8000.0	8000.0		8000.0	13000.0	9000.0	11000.0	17000.0	10000.0	7000.0	7000.0	8000.0
11	10000.0	8000.0		7000.0	11000.0	11000.0	15000.0	16000.0	8000.0	11000.0	8000.0	8000.0
12	9000.0	7000.0		10000.0	10000.0	11000.0	19000.0	12000.0	8000.0	11000.0	8000.0	8000.0
13	8000.0	9000.0		10000.0	9000.0	13000.0	16000.0	13000.0	9000.0	11000.0	9000.0	8000.0
14	7000.0	8000.0		5000.0	9000.0	14000.0	14000.0	11000.0	14000.0	9000.0	8000.0	9000.0
15	5000.0	9000.0		9000.0	7000.0	14000.0	13000.0	16000.0	11000.0	8000.0	9000.0	9000.0
16	9000.0	10000.0		8000.0	11000.0	15000.0	16000.0	13000.0	10000.0	9000.0	11000.0	7000.0
17	7000.0	9000.0		7000.0	10000.0	13000.0	12000.0	11000.0	8000.0	8000.0	9000.0	9000.0
18	10000.0	9000.0		11000.0	14000.0	11000.0	12000.0	11000.0	7000.0	9000.0	9000.0	9000.0
19	9000.0	8000.0		11000.0	16000.0	10000.0	12000.0	7000.0	7000.0	10000.0	8000.0	9000.0
20	8000.0	9000.0		11000.0	9000.0	11000.0	17000.0	11000.0	7000.0	7000.0	9000.0	9000.0
21	9000.0	7000.0		10000.0	10000.0	12000.0	15000.0	7000.0	9000.0	7000.0	7000.0	10000.0
22	7000.0	10000.0		7000.0	7000.0	18000.0	16000.0	11000.0	7000.0	8000.0	8000.0	8000.0
23	9000.0	9000.0		9000.0	10000.0	17000.0	14000.0	9000.0	8000.0	7000.0	10000.0	9000.0
24	8000.0	9000.0		8000.0	13000.0	12000.0	15000.0	11000.0	8000.0	7000.0	7000.0	10000.0
25	11000.0	7000.0		7000.0	18000.0	14000.0	7000.0	10000.0	6000.0	10000.0	8000.0	9000.0
26	10000.0	7000.0		8000.0	9000.0	10000.0	15000.0	8000.0	9000.0	9000.0	9000.0	9000.0
27	9000.0	8000.0		9000.0	10000.0	10000.0	15000.0	9000.0	14000.0	9000.0	7000.0	9000.0
28	8000.0	8000.0		10000.0	11000.0	12000.0	52000.0	9000.0	15000.0	8000.0	8000.0	10000.0
29	9000.0			8000.0	10000.0	16000.0	13000.0	9000.0	8000.0	7000.0	9000.0	8000.0
30	8000.0			8000.0	10000.0	13000.0	14000.0	10000.0	7000.0	7000.0	10000.0	9000.0
31	8000.0				13000.0		11000.0	13000.0		8000.0		9000.0

Site Name: Val Harbour Subdivision Drinking Water System

Source ID: 500000549101 Source Name: Lake Simcoe Source Type: Well

UTM(Zone/Easting/Northing): 17/835270.0/4936100.0 Method of Determination: Metered Unit of Measure: Litre

Description: Well #2 Purpose Category: Public administration Specific Category: Municipal Supply Activity: Water Supply

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
1	22000.0	20000.0	24000.0	15000.0	18000.0	27000.0	26000.0	32000.0	35000.0		25000.0	18000.0
2	17000.0	20000.0	28000.0	12000.0	21000.0	25000.0	33000.0	33000.0	21000.0		24000.0	17000.0
3	23000.0	22000.0	19000.0	23000.0	22000.0	22000.0	22000.0	43000.0	23000.0		20000.0	19000.0
4	22000.0	19000.0	20000.0	12000.0	26000.0	27000.0	39000.0	40000.0	18000.0		19000.0	18000.0
5	23000.0	20000.0	19000.0	12000.0	26000.0	17000.0	34000.0	25000.0	21000.0		20000.0	14000.0
6	16000.0	19000.0	16000.0	21000.0	17000.0	24000.0	38000.0	33000.0	20000.0	14000.0	20000.0	23000.0
7	19000.0	19000.0	19000.0	24000.0	17000.0	27000.0	22000.0	28000.0	28000.0	21000.0	17000.0	21000.0
8	10000.0	21000.0	20000.0	19000.0	21000.0	30000.0	29000.0	28000.0	22000.0	22000.0	21000.0	17000.0
9	20900.0	22000.0	21000.0	23000.0	20000.0	25000.0	22000.0	27000.0	29000.0	20000.0	21000.0	18000.0
10	17000.0	20000.0	16000.0	18000.0	29000.0	21000.0	24000.0	39000.0	23000.0	18000.0	17000.0	17000.0
11	23000.0	18000.0	19000.0	18000.0	27000.0	26000.0	35000.0	36000.0	17000.0	24000.0	17000.0	20000.0
12	20000.0	17000.0	20000.0	23000.0	23000.0	25000.0	43000.0	28000.0	19000.0	24000.0	15000.0	17000.0
13	20000.0	19000.0	19000.0	22000.0	20000.0	29000.0	39000.0	30000.0	22000.0	27000.0	20000.0	22000.0
14	14000.0	19000.0	16000.0	21000.0	20000.0	32000.0	31000.0	25000.0	30000.0	21000.0	18000.0	21000.0
15	13000.0	21000.0	22000.0	19000.0	38000.0	34000.0	30000.0	38000.0	27000.0	18000.0	22000.0	21000.0
16	20000.0	23000.0	22000.0	33000.0	25000.0	35000.0	39000.0	29000.0	3000.0	20000.0	25000.0	16000.0
17	16000.0	20000.0	6000.0	17000.0	23000.0	28000.0	27000.0	25000.0		19000.0	20000.0	18000.0
18	23900.0	20000.0		28000.0	32000.0	25000.0	28000.0	28000.0		21000.0	20000.0	21000.0
19	21000.0	20000.0		23000.0	38000.0	23000.0	29000.0	17000.0		22000.0	19000.0	21000.0
20	19000.0	20000.0		27000.0	21000.0	27000.0	39000.0	23000.0		18000.0	20000.0	21000.0
21	20000.0	16000.0		21000.0	21000.0	26000.0	35000.0	18000.0		16000.0	18000.0	23000.0
22	16000.0	23000.0		17000.0	18000.0	43000.0	35000.0	23000.0		18000.0	18000.0	20000.0
23	20000.0	21000.0	17000.0	20000.0	22000.0	38000.0	34000.0	21000.0		16000.0	21000.0	19000.0
24	19000.0	19000.0	20000.0	15000.0	29000.0	29000.0	35000.0	24000.0		17000.0	18000.0	23000.0
25	23000.0	17000.0	16000.0	19000.0	42000.0	31000.0	16000.0	24000.0		21000.0	18000.0	21000.0
26	25000.0	16000.0	16000.0	18000.0	26000.0	23000.0	37000.0	19000.0		22000.0	20000.0	22000.0
27	19000.0	19000.0	19000.0	20000.0	23000.0	25000.0	37000.0	21000.0		21000.0	18000.0	20000.0
28	20000.0	17000.0	16000.0	23000.0	25000.0	25000.0	121000.0	20000.0		17000.0	16000.0	24000.0
29	19000.0		19000.0	19000.0	23000.0	37000.0	31000.0	21000.0		17000.0	23000.0	17000.0
30	19000.0		19000.0	18000.0	23000.0	31000.0	32000.0	22000.0		17000.0	23000.0	20000.0
31	19000.0		16000.0		31000.0		25000.0	30000.0		17000.0		21000.0

**REV. 0 VAL HARBOUR DRINKING WATER SYSTEM - 2025 ANNUAL REPORTS
ISSUED: FEBRUARY 13, 2026**

Site Name: Val Harbour Subdivision Drinking Water System

Source ID: 500000549100 Source Name: Well #3 Source Type: Well

UTM(Zone/Easting/Northing): 17/635465.0/4936808.0 Method of Determination: Metered Unit of Measure: Litre

Description: Well #3R Purpose Category: Public administration Specific Category: Municipal Supply Activity: Water Supply

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
1										26000.0		
2									1000.0	25000.0		
3			1000.0							24000.0	1000.0	
4						1000.0				26000.0		
5					1000.0			1000.0		26000.0		
6										11000.0		
7				1000.0								
8												
9												
10												
11												
12												
13												
14												
15					30000.0							
16				21000.0					27000.0			
17			11000.0						27000.0			
18			20000.0						23000.0			
19			19000.0						23000.0			
20			19000.0						24000.0			
21			19000.0						26000.0			
22			26000.0						23000.0			
23									20000.0			
24									27000.0			
25									21000.0			
26					8000.0				28000.0			
27									49000.0			
28					3000.0				52000.0			
29									27000.0			
30									22000.0			
31												

Name of Attester

First Name: Natalie

Last Name: Lamiot

Company: Ontario Clean Water Agency

Date Certified/Submitted(yyyymmdd): 2026/02/13